



Sprague River Road Facility Plot Plan

- KEY:**
- 1st Valve inside Secondary Containment
 - Pipeline to 1st Valve
 - Property Line
 - NEL Aboveground pipeline
 - NEL Underground pipeline
 - Soil Containment Berm


PLAN REFERENCES:

- STATE OF NEW HAMPSHIRE, DEPARTMENT OF TRANSPORTATION, BUREAU OF HIGHWAY DESIGN, NEWINGTON-DOVER, SHEET 22, PHOTOGRAMMETRIC MAP, PHOTOGRAMMETRIC MAPPING BY QUINN ASSOCIATES, MARCH 29, 1990. REVISED FOR APPLIEDORE ENGINEERING, INC., AUGUST 1992.
- APPLIEDORE ENGINEERING, INC., SITE INSPECTIONS, MARCH 17, 1992 AND AUGUST 4, 1992.
- SHOALS CORPORATION, DOCKING FACILITY REHAB - NEWINGTON ATC PETROLEUM, INC., NOVEMBER 2, 1978, SHEETS 1 THROUGH 4 OF 4.
- NEW ENGLAND DIVISION OF CORPS OF ENGINEERS, PORTSMOUTH HARBOR AND PISCATAQUA RIVER - MAINE AND NEW HAMPSHIRE, CONDITION SURVEY 35 FOOT CHANNEL, MAY 1985, SHEET 5 OF 5.

NOTES:

- COORDINATES ARE BASED ON THE TRANSVERSE MERCATOR GRID SYSTEM FOR THE STATE OF NEW HAMPSHIRE.

Tank No.	Substance Stored (Oil & Hazardous Substance)	Max. Capacity (barrels)	Tank No.	Substance Stored (Oil & Hazardous Substance)	Max. Capacity (barrels)
Bulk Product Storage Tanks					
250001	Distillate/#2 fuel oil	251,608	5001	Out of Service	5,135
217001	Distillate/#2 fuel oil	217,091	2501	No. 5 Fuel Oil	2,433
200001	Distillate/LS Diesel	198,708	TS01	Diesel (Retail)	500
55001	Distillate/Kerosene	59,127	Other Product Storage Tanks		
55002	Distillate/LS Diesel	59,947	D1	Additive	238
55003	Distillate/Kerosene	58,804	C1	Additive	48
30001	Asphalt	30,040	A1	Heat Force Additive	48
30002	Asphalt	29,995	T19	Additive	19
30003	Asphalt	29,963	T10	Additive	10
30004	Asphalt	29,964	48	Waste Oil	48
30005	Distillate/Kerosene	30,070	RD1	Red Dye	7
30006	Distillate/LS Diesel	30,044	LA1	Additive	7
15001	Out of Service	15,102	RD2	Red Dye	7
15002	Out of Service	14,894	LA2	Additive	7
11001	Distillate/LS Diesel	11,256	RO1	Recyclable Oil	12
11002	Distillate/Kerosene	11,256	KRO2	Kero Recyclable Oil	6.5
10001	Tallow	10,104	DS1	Diesel	6.5
10002	Tallow	10,095	HO1	Heating Oil	7
10003	Tallow	10,103	HO2	Heating Oil	7
10004	Tallow	10,116	HO3	Heating Oil	12
7001	Tallow	7,147	Secondary Containment Systems		
7002	Tallow	7,166	Containment Area A		382,000
7003	Distillate/Kerosene	6,420	Containment Area B		221,500
7004	ULS Diesel	6,457	Containment Area C		35,700

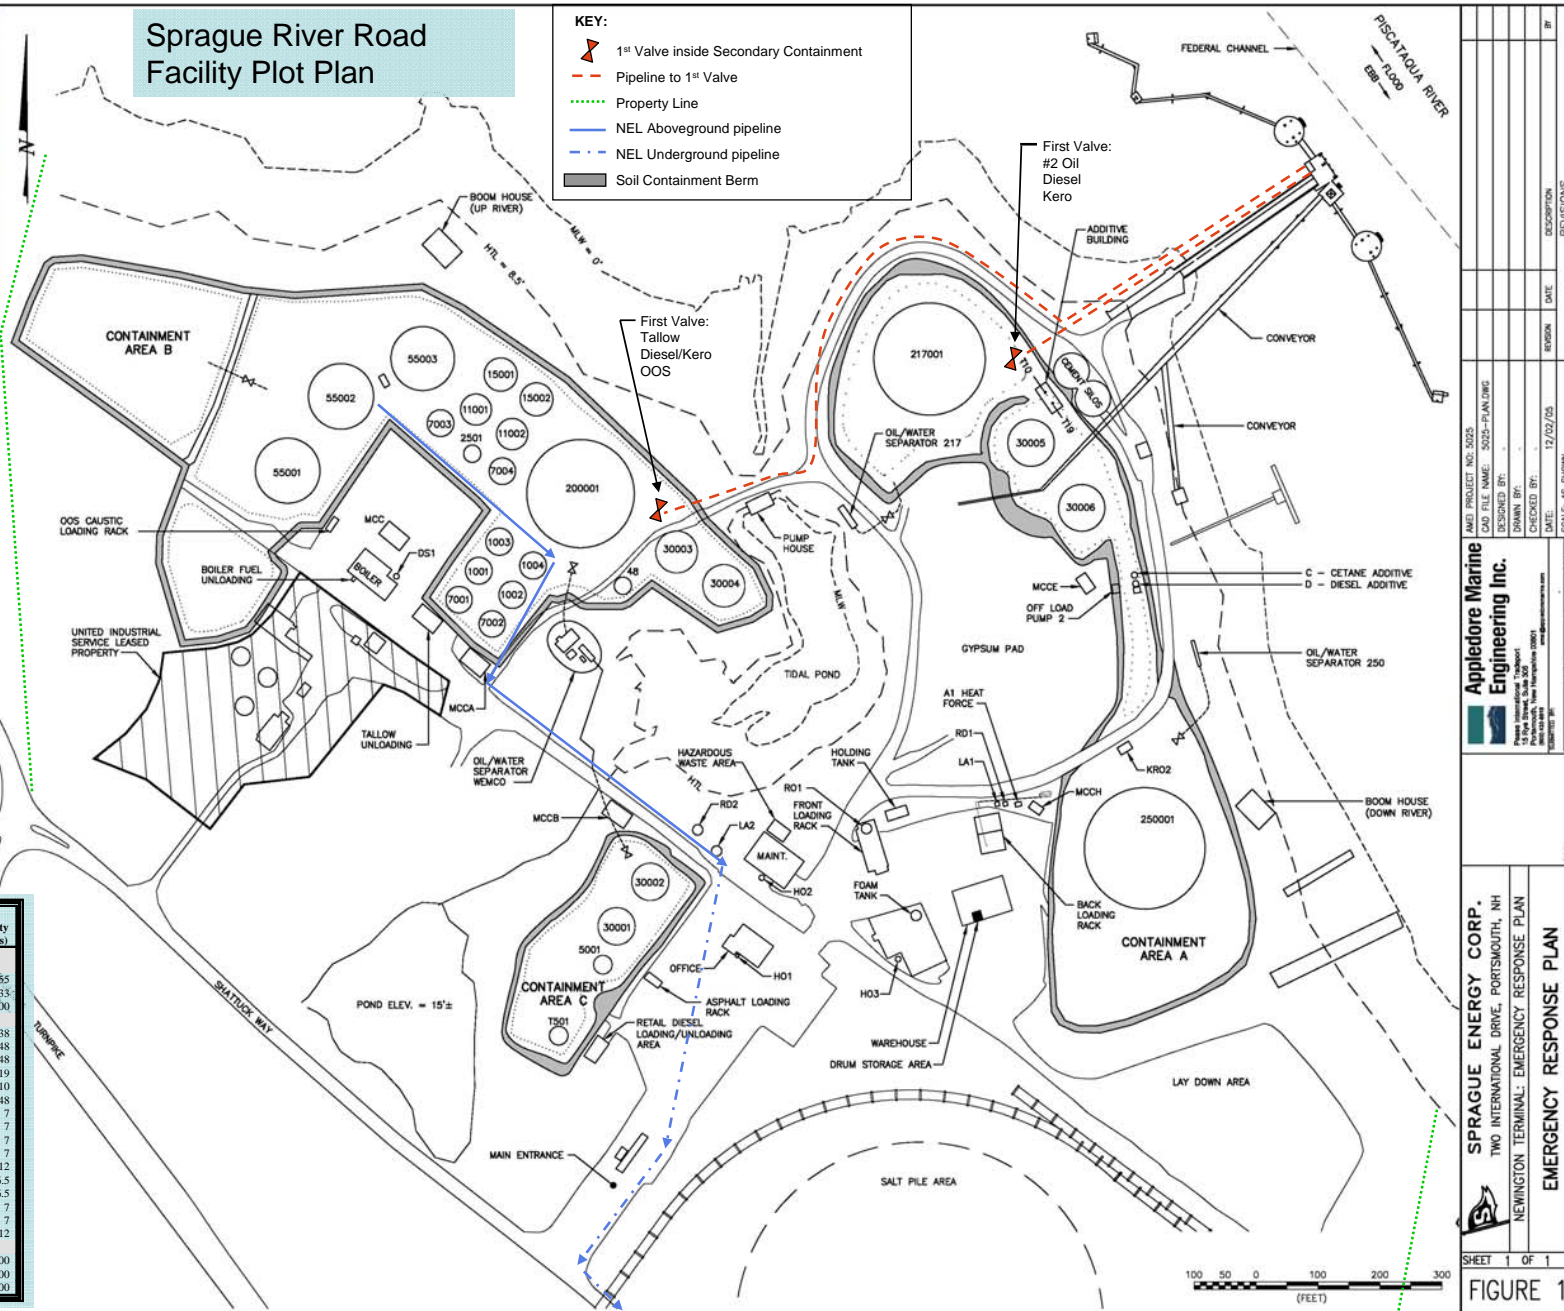

PROJECT NO. 5025
FILE NAME: 5025-PJ-ENG
DRAWN BY: JBT
CHECKED BY: JBT
DATE: 12/02/03
SCALE: AS SHOWN

Appliedore Marine Engineering Inc.
13 Blue Street, Suite 300
Newington, New Hampshire 03801
Tel: 603.883.1111
Fax: 603.883.1112
Email: info@appliedore.com

SPRAGUE ENERGY CORP.
TWO INTERNATIONAL DRIVE, PORTSMOUTH, NH
NEWINGTON TERMINAL: EMERGENCY RESPONSE PLAN
EMERGENCY RESPONSE PLAN

SHEET 1 OF 1
FIGURE 1